


OPEN INSIDE DROP


NOTES:

1. All manhole 60-inch riser sections shall conform to the requirements of ASTM C-478 and applicable provisions of *HANOVER specifications*.
2. Pipe and fittings for drop assembly shall be same size as inflow pipe to manhole.
Pipe and fittings for drop assembly shall be:
3. ductile iron ANSI A21.50-1, AWWA C150-1, AWWA C-900 or PVC ASTM 3034 SDR 35.
4. Pipe connections of four or more mainlines shall require a manhole connection and channel detail.
5. Provide a minimum of 8-inches of intact (undisturbed) manhole wall between pipe breakouts as measured on the inside face of the manhole.
6. No more than 8-inches of riser rings shall be used.
Minimum drop between inlet and outlet to be
7. not less than 0.10 feet.
HANOVER reserves the right to deviate from
8. this drawing and related requirements in the Town of Hanover Standard Specifications,
9. Sewer User Ordinance as dictated by project design parameters, and as approved by the Director of Public Works.

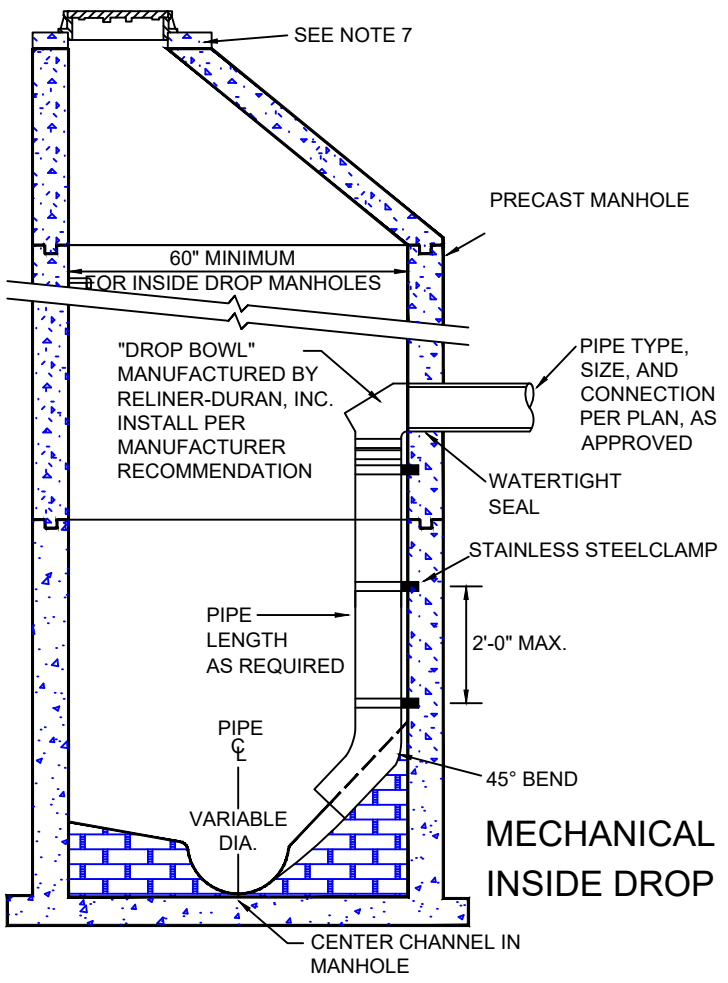

MECHANICAL INSIDE DROP

SANITARY SEWER INSIDE DROP

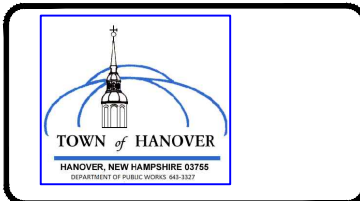

SANITARY SEWER INSIDE DROP MANHOLE		
DATE MAY 2020	DRAWN BY PEK	DRAWING NO. S-2