



INSERT "A"

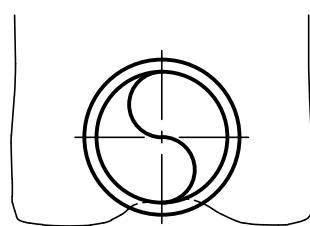

INSERT "B"

OPTIONAL ONLY WHEN
SOIL CONDITIONS ARE
EQUAL TO 6" MIN.
BEDDING SAND WITH
THOROUGH COMPACTION

NOTES:

1. ALL MATERIALS AND INSTALLATION PROCEDURES WILL CONFORM TO HANOVER TECHNICAL SPECIFICATIONS.
2. ALL PIPE SHOULD HAVE A MINIMUM DEPTH OF 5' 6" FROM TOP OF PIPE TO FINISH GRADE.
3. REQUIREMENTS FOR SUBBASE AND BASE MATERIAL TYPE ARE TO BE IN ACCORDANCE WITH TRENCH RESTORATION DETAIL H-5 IN PAVED AREAS.
4. REQUIREMENTS FOR GRAVEL, LOAM AND/OR SEED ARE TO BE IN ACCORDANCE WITH HANOVER H-3 CROSS COUNTRY TRENCH RESTORATION DETAIL IN NON-PAVED AREAS.



DETAIL W-16
TYPICAL TRENCH DETAIL

TOWN OF HANOVER
REV: 5-01 BY: PEK SCALE: NTS