
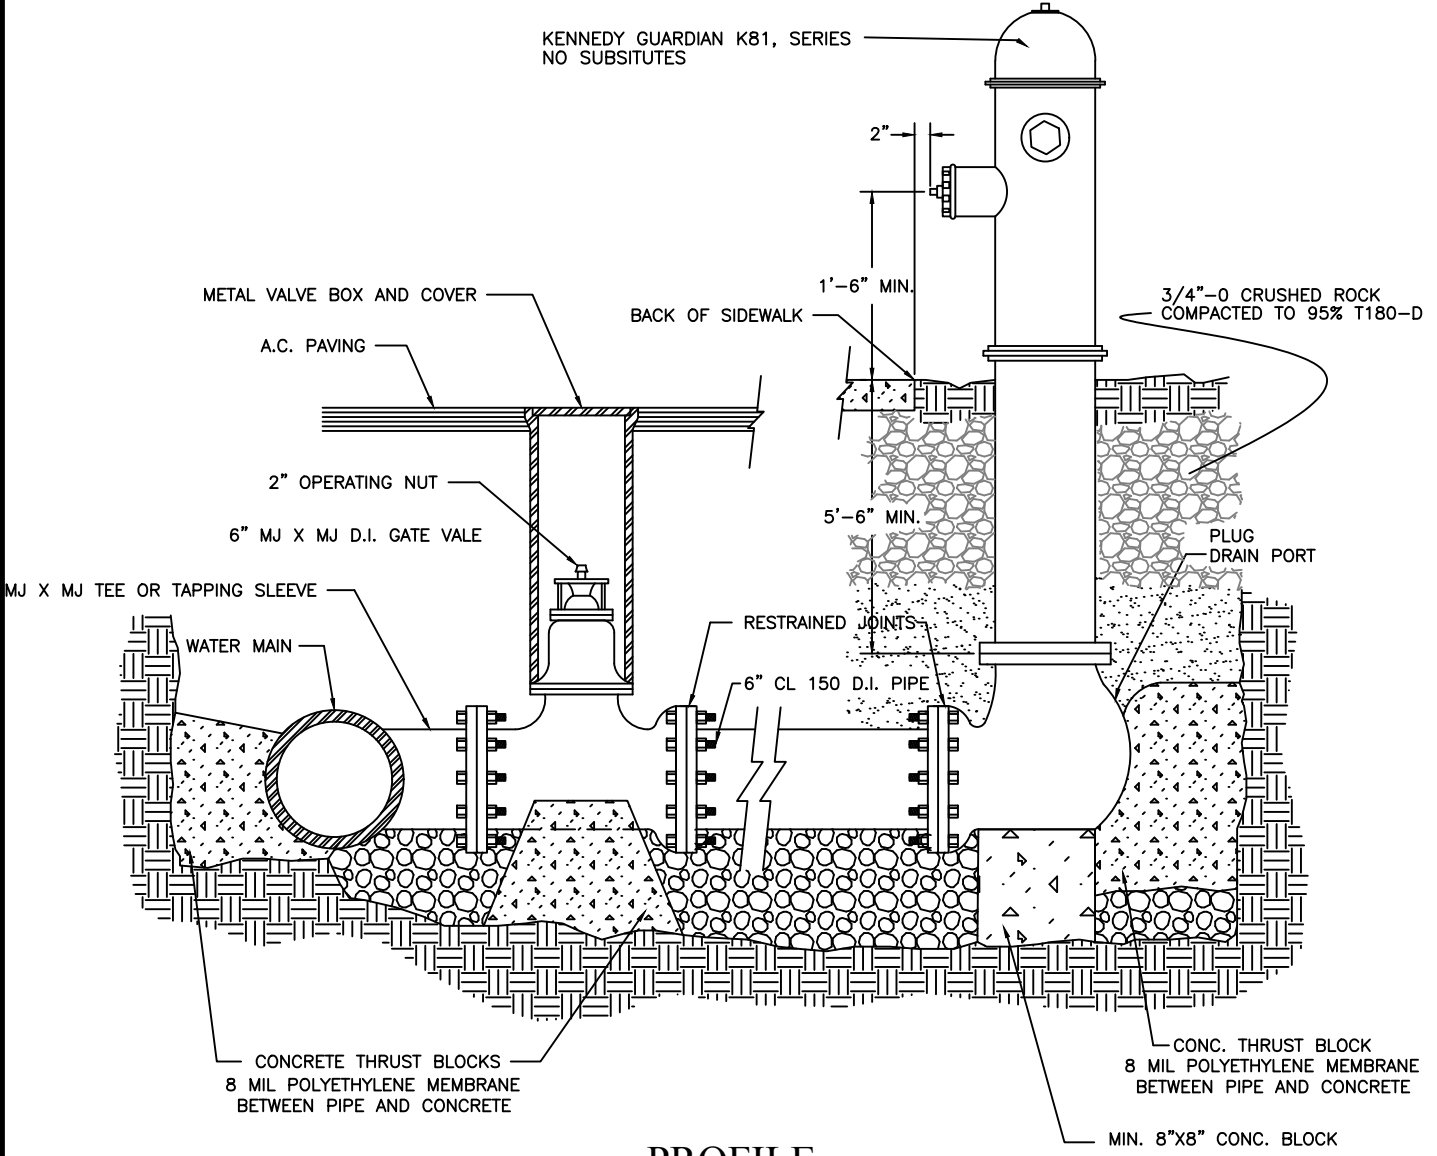


3' MINIMUM SPACE AROUND ALL SIDES OF HYDRANT INCLUDING VEGETATION



PROFILE

NOTE:
 INTERNAL COUPLING SHALL BE STAINLESS STEEL.
 HYDRANT SHALL HAVE 2 HOSE AND ONE PUMPER NOZZLE.
 HYDRANT SHALL COMPLY WITH AWWA C502 STANDARDS.

FILE: W-4 FIRE HYDRANT.DWG

TOWN OF
HANOVER

UNIFORM STANDARDS
 FOR
 PUBLIC WORKS CONSTRUCTION

CHECKED	DATE	W-4
PEK	6/14	
APPROVED	DATE	
PEK	6/14	